THERMOLEC

Acusteam Continuous Red Light Code

CAUTION

WARNING For electric shock Disconnect all power before working within the unit

Must be performed by licensed technician

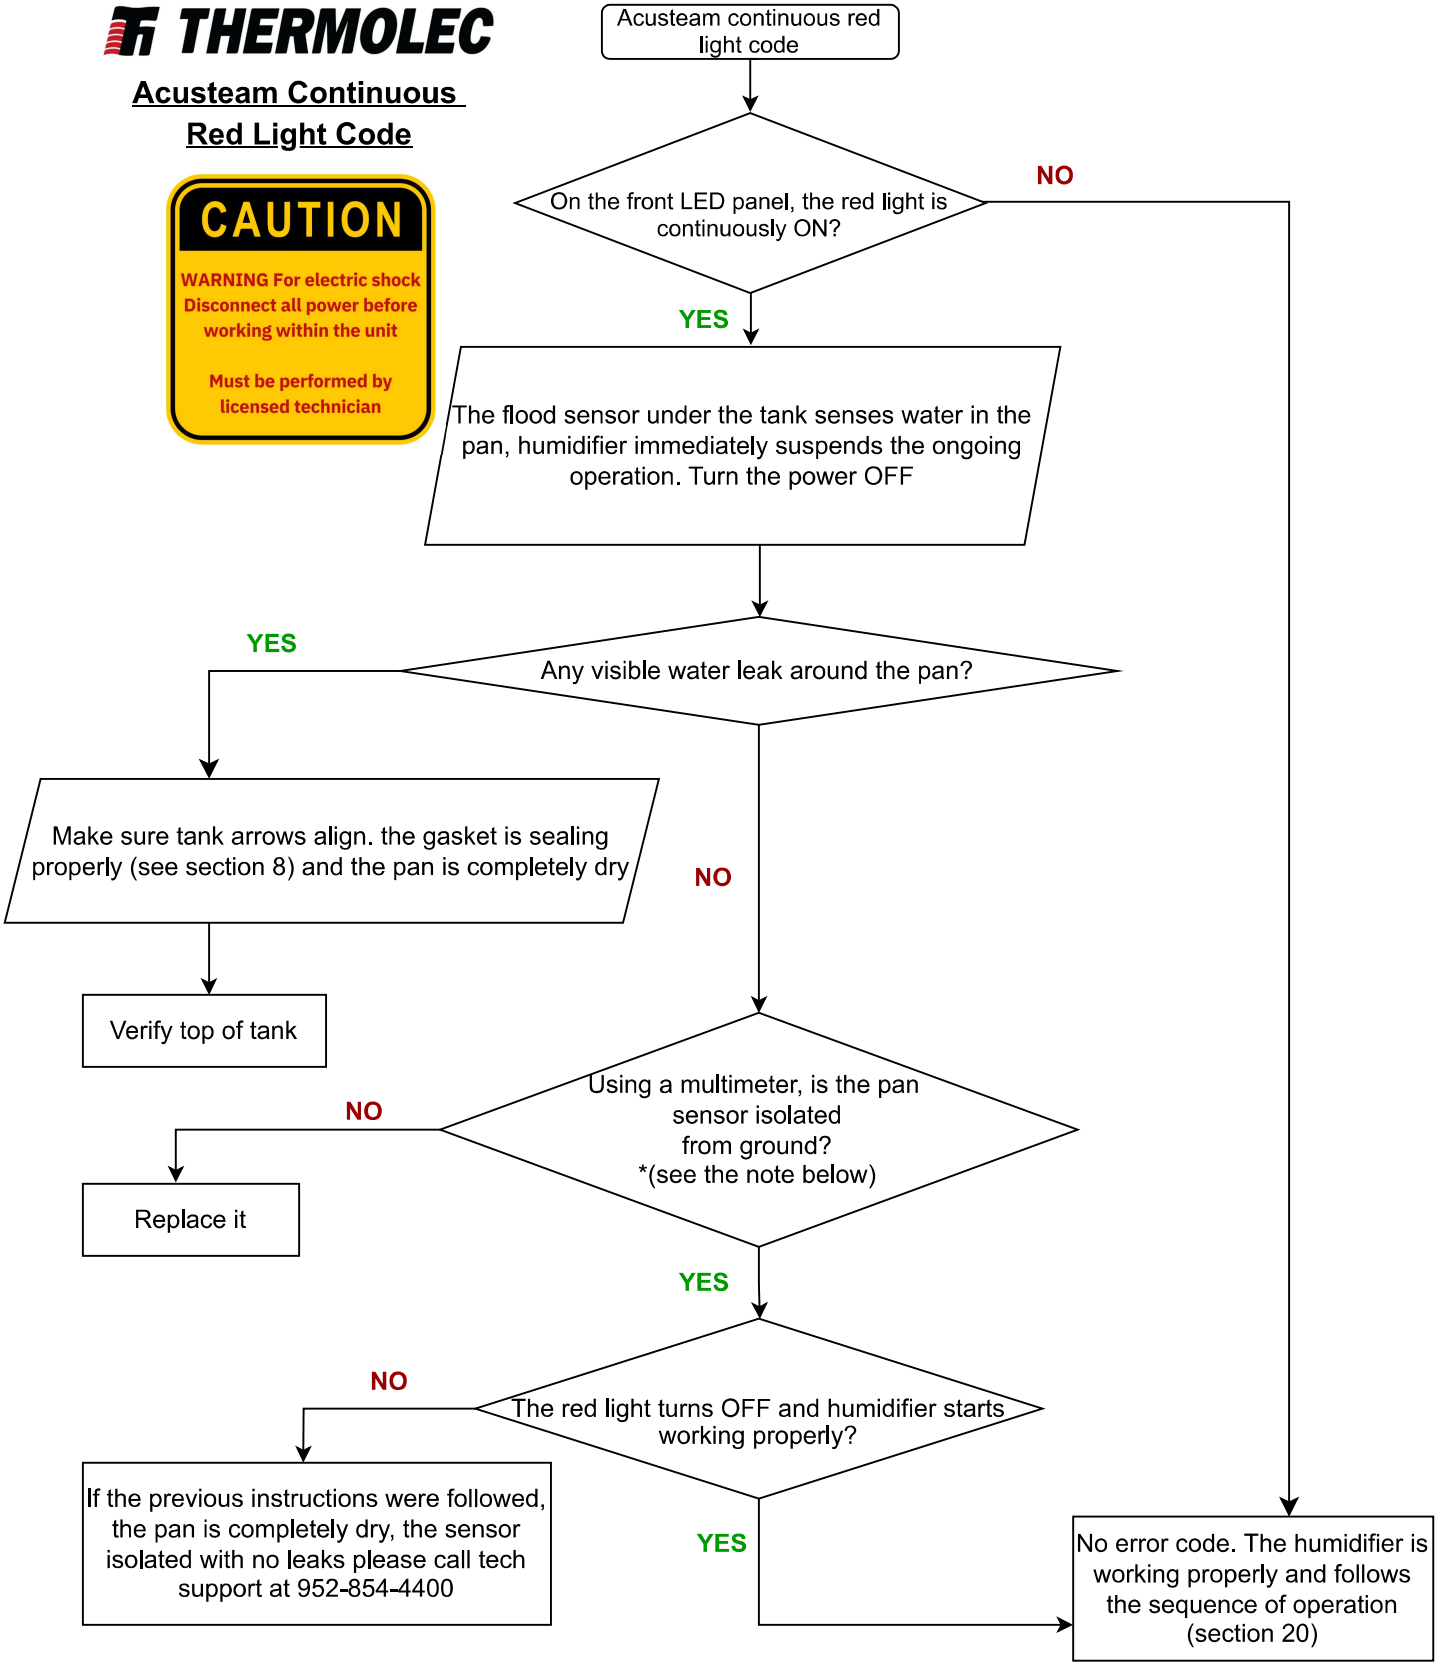

*Note: To verify if the pan sensor is isolated from the Ground, turn power OFF and use the multimeter on continuity mode across the sensor and Ground

NOTE: Please put back connections and jumpers as per wiring diagram

Version 1.1 - 2024.05.10